


## DYWIDAG Reinforcement Systems

### FLIMU-System

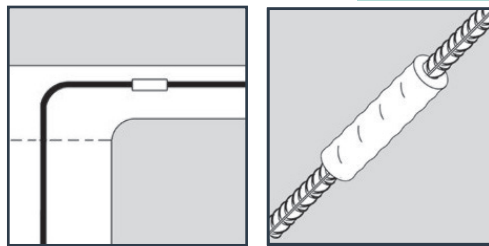

**Mechanical Connection and Anchorage of Reinforcing Steel Bar by means of Extruded Couplers  
Nominal Diameter: 16 to 32 mm  
"FLIMU-System"**

**Approval Number  
Z-1.5-150  
Validity  
29 September 2009 -  
30 September 2014**

**DEUTSCHES INSTITUT FÜR BAUTECHNIK**  
(Institute for Construction Engineering)  
Statutory Body

10829 Berlin, 29<sup>th</sup> September 2009  
Kolonnenstrasse 30 L  
Telephone: (030) 78730-0  
Telefax: (030) 78730-320  
Reference: I 19-1.1.5-32/08

## **APPROVAL CERTIFICATE**

**Approval Number:**

Z-1.5-150

**Applicant:**

DYWIDAG-Systems International GmbH  
Siemensstrasse 8  
85716 Unterschleissheim

**Object of Approval:**

Mechanical Connection and Anchorage  
of Reinforcing Steel Bar by means of  
Extruded Couplers  
Nominal Diameter: 16 to 32 mm  
"FLIMU-System"

**Valid until:**

30<sup>th</sup> September 2014

The aforementioned Object of Approval is hereby generally approved by the supreme construction authorities in accordance with building legislation.

This approval certificate comprises eight pages and four appended sheets.

This certificate supersedes the approval certificate No. Z-1.5-150 dated 8<sup>th</sup> April 2005.

The Object of Approval was first approved on 1<sup>st</sup> May 1988.

### **Important Notice**

This Approval Certificate is the translation of a document originally prepared in the German language which has not been verified and officially authorized by the "Deutsches Institut für Bautechnik" (DIBt; German Institute for Construction Engineering). In case of doubt in respect to wording and/or interpretation of this approval, the original German version of this document shall prevail exclusively. No liability is therefore assumed for translation errors or inaccuracies.

## I. GENERAL PROVISIONS

- 1 This approval constitutes demonstration of usability and applicability resp. of the object as called for by state construction regulations in Germany.
- 2 As far as in this approval requirements are set for special know-how and experience of the personal in charge of the performance of construction products and construction methods as per § 17, section 5 of the classic construction rules according to the state regulations, it must be considered that this know-how and experience can also be proofed by equivalent verifications of other member countries of the European Union. If necessary, this is also valid for the provision of equivalent verifications in line with the Treaty on the European Economic Area or other bilateral agreements.
- 3 This approval does not replace the permissions, consents and certificates as required by German law for carrying out construction projects.
- 4 Approval is granted without prejudice to third party rights, particularly private protection rights.
- 5 Beside the regulations in the "Special Provisions", the manufacture and supplier of the object shall submit to the user a copy of this approval certificate; furthermore they shall inform the user that this approval certificate shall be available at the construction site. On request, a copy of this approval certificate shall be submitted to all involved authorities.
- 6 This approval may only be copied in its entirety. Any excerpt to be published from this approval certificate shall be subject to approval of Deutsches Institut für Bautechnik. The text and the drawings of advertising literature shall not be inconsistent with the approval certificate. Translations of the approval certificate must contain the indication that the wording is not as authorized by Deutsches Institut für Bautechnik.
- 7 This approval will be given revocable. The provisions of this approval may be amended or modified and in particular whenever new technical findings justify this measure.

## II. SPECIAL PROVISIONS

### 1 Object of Approval and Application Range

#### 1.1 Object of Approval

(1) Object of this approval is the mechanical connection and anchorage of reinforcing steel bars by means of extruded couplers (see Appendix 1) – in the following named as Extruded Coupler Splice.

(2) The extruded coupler splice will be produced at site by means of a reducing ring (die) by continuous cold-extruding a steel coupler joining the butted ends of reinforcing steel bars. Thus a connection is created between the ripped surface of the reinforcing steel and the inner surface of the extruded coupler through which the full bar load will be transferred.

(3) Bars with equal or unequal surface deformation – e.g. bars with skew ribs as per DIN 488-1<sup>1</sup> and bars with threaded ribs as per approval certificate – may be connected with extruded couplers.

(4) The nominal diameter of the connecting reinforcing steel bars ranges from 16 to 32 mm. Also, bars with different diameter may be connected as long as the diameters are neighbouring in the standardized diameter sequence (extruded reducing coupler).

(5) Reinforcing Steel Bars with threaded ribs (GEWI-Steel) and reinforcing steel bars Ø 32 mm require an approval certificate.

#### 1.2 Application Range

Reinforcing steel bars will be anchored and spliced according to the provisions of DIN 1045-1<sup>1</sup>, sections 12.6 and 12.8.

Splices and anchorages with reinforcing steel BSt 420 S may be used only for predominantly static loading.

## **2 Provisions for the Construction Product**

### **2.1 Properties and Composition**

#### **2.1.1 Material Properties**

The basic material for the extruded couplers and anchorages is specified in the Appendix Sheets 1 and 2. The necessary requirements for the material properties, as per mentioned codes, must be fulfilled.

#### **2.1.2 Geometry**

(1) The geometrical dimensions as well as the permissible tolerances are specified for the extruded couplers in Appendix Sheet 1, Table 1 and for the extruded reducing couplers in Appendix Sheet 1, Table 2.

(2) The geometrical dimensions for the anchor piece, anchor plate and anchor nut are specified in Appendix Sheet 3, Table 3.

### **2.2 Manufacture and Identification**

#### **2.2.1 Manufacture**

(1) The couplers will be cut to the required length in the manufacturer plant. For positioning the reducing ring (die) at the later assembly at site, one front side of the coupler will be chamfered outside.

(2) Depending on the used material, the anchorage components will be either cast in their final shape or cut to size.

## **2.2.2 Identification and Packing**

(1) In the manufacturer plant each coupler and each anchorage component must be marked with the manufacturer symbol as illustrated in the Appendices 1 and 2 as well as with the data about the joining nominal diameter and the type of reinforcing steel.

(2) The packing of the extruded couplers and the delivery note must be marked by the manufacturer with the conformity symbol (Ü-Symbol) according to the conformity symbol decree issued by the Länder (German States). The identification may be applied only when the requirements have been met according to section 2.3.

## **2.3 Conformity Verification**

### **2.3.1 General**

(1) For every manufacturer plant with conformity certificates based on in-house production checking and periodical external inspections including a first testing of the construction product, the confirmation of conformity of the construction product with the provisions of this approval will be provided according to the following provisions.

(2) For granting of the conformity certificate and external inspection including the nearby carried out production tests, the manufacturer of the construction product has to appoint both a certification institution and an inspection agency which are acknowledged in this field.

(3) The Institute of Construction Engineering must receive as information a copy of the issued conformity certificate from the certification institution.

### **2.3.2 In-House Production Checking**

(1) In every manufacturer plant, an in-house production checking has to be established and implemented. The manufacturer understands by the meaning "in-house production supervision" to undertake a continuous inspection of production, which ensures, that the manufactured construction product complies with the provisions of this approval certificate.

(2) The in-house production checking shall at least include such measures which are defined in the "Principles for Approval – and Inspection Tests of mechanical connections – edition May 2007.

(3) Verification of the material properties of the basic material for couplers must be attested with an Inspection Certificate according to DIN EN 10 204<sup>3</sup>, section 2.3.

(4) Hardness tests for inspecting the strength must be performed at least once a day or after every 500 couplers.

(5) According to statistical criteria, 5 % of the manufactured couplers must be sampled and the dimension values for length, outer diameter, inner diameter and wall thickness (at 90° staggered points) inspected, using suitable gauges.

(6) The productive amplitude of the manufactured extruded coupler splice under jobsite conditions must be checked for each diameter at least once per year.

(7) The results of the in-house production checking shall be recorded and evaluated. The evaluations shall at least include the following information:

- Description of construction product and basic material with constituent parts respectively
- Way of checking or testing
- Dates of manufacture and testing of the construction product and basic material or the constituent parts respectively
- Results of checking and testing and if applicable comparison with the requirements
- Signature of responsible person for the in-house production checking

(8) The records shall be kept for a period of at least 5 years and submitted to the nominated inspection agency for the external inspection. On request, they have to be submitted to the Institute of Construction Engineering and the responsible Supreme Construction Authorities.

(9) In case of insufficient test results, the manufacturer must immediately arrange the necessary measurements in order to abolish the defect. Construction products which do not comply with the requirements must be handled in such a way to exclude any confusion with complying products. After abolishment of the defect - as far as technically possible and as verification of the defect removal - the corresponding test must be repeated immediately.

### **2.3.3 External Inspection**

(1) In every manufacturer plant, the in-house production checking shall be periodically reviewed by the external inspection agency according to the mentioned principles as per section 2.3.2 (2), but at least twice a year.

(2) Within the scope of external inspection, specimen for random samples shall be taken according to the mentioned principles as per section 2.3.2 (2).

(3) Within the scope of continuous inspection regarding the performed tensile tests, the evaluations must be checked according to section 4.3.2 (4).

(4) The results of certification and external inspection shall be kept for a period of at least 5 years. They are to be submitted by the certification institution or inspection agency to the Institute for Construction Engineering and the responsible Supreme Construction Authorities on request.

## **3 Provisions for Planning and Design**

### **3.1 General**

(1) For planning and design applies section 1.2 as well as the following provisions.

(2) All bars in a cross-section may be spliced (full splice).

(3) The position and dimension of coupler splices and anchorages must be illustrated in the reinforcement shop drawings and the conditions of the installation instructions must be fulfilled.

## **3.2 Permissible Loadings**

### **3.2.1 Predominantly Static Loading**

Splices and Anchorages of this approval may be loaded to 100 % at a predominantly tensile load like an unspliced bar.

### **3.2.2 Not predominantly Static Loading**

For the design according to DIN 1045-1<sup>2</sup>, a verification against fatigue as per section 10.8 of this code must be carried out. For splices and anchorages with reinforcing steel BSt 500 S, nominal diameter 16 to 32 mm,  $\Delta\sigma_{Rsk} = 90 \text{ N/mm}^2$  must be considered as characteristic value of the fatigue strength, constantly for the stress cycles endured range from zero up to 2 mill. load cycles.

For the stress cycles endured range from 2 to 10 mill. load cycles a rise factor  $k_1 = 3$  and for those higher than 10 mill load cycles a rise factor  $k_2 = 5$  has to be considered for the progress of the characteristic stress amplitude (compare DIN 1045-1<sup>2</sup>, figure 52).

Splices and anchorages with reinforcing steel BSt 420 S may be used for predominantly static loading only.

### **3.3 Concrete Cover and Bar Distance**

(1) For the concrete cover over the outer edge of a coupler or an anchorage element as well as for the clear distance of outer edges of couplers or anchorage elements apply the same values as for unspliced bars according to DIN 1045-1<sup>2</sup>, section 6.3 or section 12.2.

(2) The – possibly larger – distances required for the installation are not affected by this.

### **3.4 Centre- and Edge Distances of Anchorages**

(1) Valid are the centre- and edge distances as specified in Appendix Sheet 3.

(2) In case the anchorages cannot be positioned in one cross section level as per 3.4, then they must be staggered at least 1,5 times of the centre distance in bar direction.

(3) If it is necessary to deviate of the distances as specified in section 3.4 (1) and (2), the absorption of the transverse tensile stresses by the transverse reinforcement or by transverse compression must be verified by calculation.

### **3.5 Bendings**

(1) The scheduled bending of a bar may start at a distance of at least  $5 \times d_s$  from the end of a coupler ( $d_s$  = nominal diameter of the bent bar).

(2) If spliced bars are bent with special equipment in the manufacturer plant, the distance from the coupler end may be reduced down to  $2 \times d_s$ .

## **4 Provisions for the Performance**

### **4.1 General**

- (1) The extruded coupler splices shall be produced by trained personnel only. For this purpose, the applicant must submit written working instructions.
- (2) Only couplers identified as described in section 2.2.2 shall be used.
- (3) The dimensions and the arrangement of the couplers must comply with the information given in the design drawings (shop drawings of the reinforcement).
- (4) No special requirements are stipulated to the evenness of the cut-ends of the reinforcing bars to be spliced, however, the squeezing which occurs at shear cuts must not extend beyond the cross-section area of the bars.
- (5) If the diameter measured across the ribs is greater than that specified for the inner diameter of the coupler as shown in Appendix Sheet 1, Table 1, the ribs may be grind-off correspondingly.
- (6) The required position of the coupler (for reducing couplers the values as mentioned in Appendix Sheet 1, Table 2 have to be kept) must be easy to examine both during and after production of the coupler splice by means of suitable markings on the bar ends.

### **4.2 Extrusion Tool and Extrusion Process**

- (1) The extruded coupler splices must be produced by using the special tools which the applicant developed for this kind of connections.
- (2) For each size of extruded coupler splice, exclusively the reducing ring (die) designed for this size may be used.
- (3) One of the bars to be spliced must be movable in longitudinal direction.

### 4.3 Inspections

#### 4.3.1 Suitability verification before commencing work

- (1) Under jobsite conditions, two extruded coupler splices of each diameter shall be produced.
- (2) The load capacity of coupler splices must be tested with required equipment by experienced personnel.
- (3) Tensile tests up to the failure shall be performed; the test results shall be recorded according to Appendix Sheet 4 and evaluated with the there mentioned notes.

#### 4.3.2 Continuous Inspection

- (1) Each coupler splice must be checked visually whether the coupler has been extruded uniformly over the entire length.
- (2) In case the number of coupler splices produced at the construction site is less than 200, the suitability verification as per section 4.3.1 will be sufficient.
- (3) For every 200 coupler splices produced, at least one tensile test must be performed by an acknowledged institution (compare 2.3.3). Here, the types of splices and the dimensions performed must be recorded representatively.
- (4) The checking by means of a tensile test is deemed to be passed if one of the following conditions – the kind of failure a) to c) must be mentioned – is fulfilled:
  - a) Fracture of a bar outside of the splice or anchorage.
  - b) Failure of the splice or anchorage (fracture of coupler or anchorage, fracture of bar in the coupler or anchorage area and pullout of bar of the coupler) above a test load of  $F_{min.} = 1,3 \times \text{specified yield load of bar} = 1,3 \times R_{e,nom} \times A_{s,nom,bar}$ .
  - c) Failure (bar fracture in the coupler or anchorage area or pullout of bar of the coupler) at an ultimate load below  $F_{min.}$  but above 1,1 times nominal yield load of the bars, as long as the load capacity of the splice is at least 95 % of the actual load capacity of the bar and the uniform elongation at maximum load is at least 3 % in case of splice failure.  
The actual bar carrying capacity and the uniform elongation  $A_{gt,v}$  must be determined at the bar which participated in the failure.

with:

$F_{t,Nenn,Stab}$  = Nominal Ultimate Load of Bar

$F_{y,Nenn,Stab}$  = Nominal Yield Load of Bar


$F_{t,Ist,Stab}$  = Actual Ultimate Load of Bar

Häusler

certified

---

1	DIN 488-1:1984-09	Reinforcement steel – Part 1: Types, Properties, Identification
2	DIN 1045-1:2008-08	Concrete, reinforced and prestressed concrete structures – Part 1: Design and construction
3	DIN EN 10204:2005-01	Metallic Products – Types of Inspection Certificates; German Version EN 10204:2004

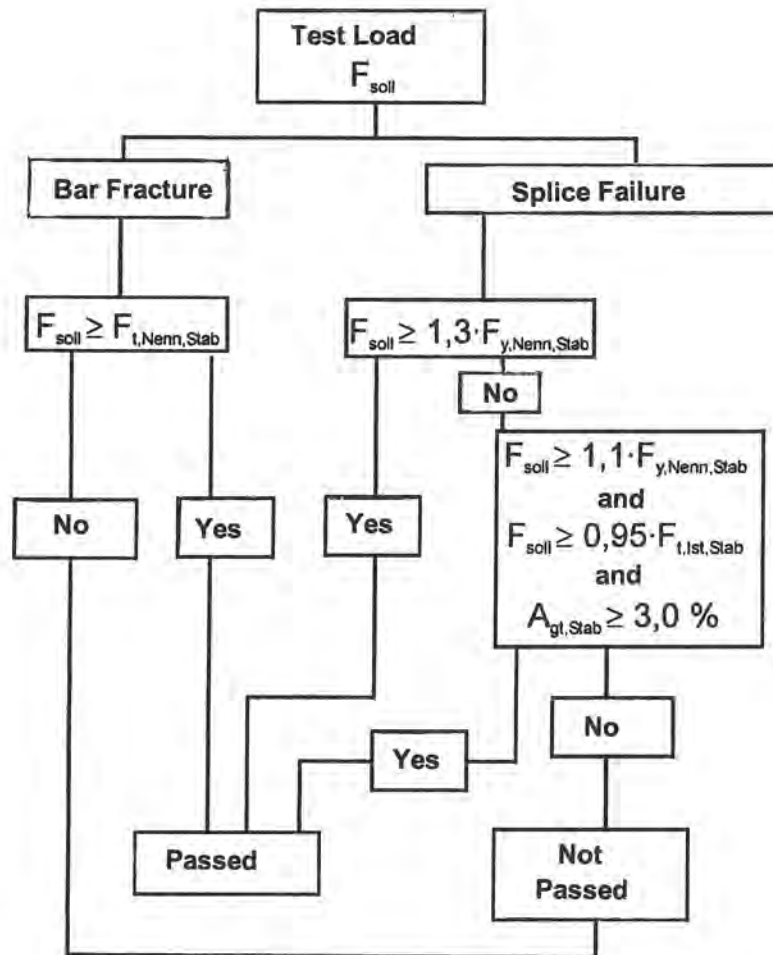

with:

$F_{t,Nenn,Stab}$  = Nominal Ultimate Load of Bar

$F_{y,Nenn,Stab}$  = Nominal Yield Load of Bar

$F_{t,Ist,Stab}$  = Actual Ultimate Load of Bar


Häusler

certified


- 
- |   |                      |   |
|---|----------------------|---|
| 1 | DIN 488-1:1984-09    | Reinforcement steel – Part 1:<br>Types, Properties, Identification                            |
| 2 | DIN 1045-1:2008-08   | Concrete, reinforced and prestressed concrete<br>structures – Part 1: Design and construction |
| 3 | DIN EN 10204:2005-01 | Metallic Products – Types of Inspection<br>Certificates; German Version EN 10204:2004         |

# EXTRUDED COUPLER SPLICE (FBM)

**Material:**  
 Precision Steel Tube according  
 DIN EN 10305-1:2003-02 E235+N  
 Material No. 1.0308

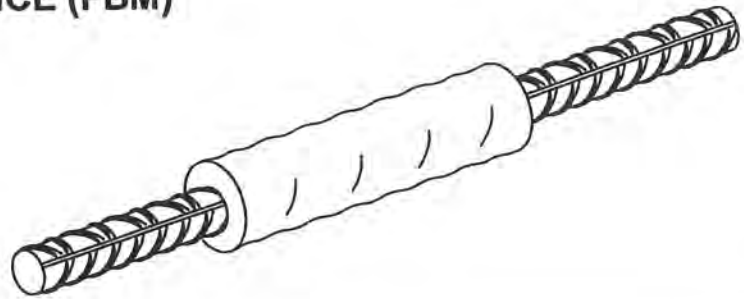

**Figure 1**

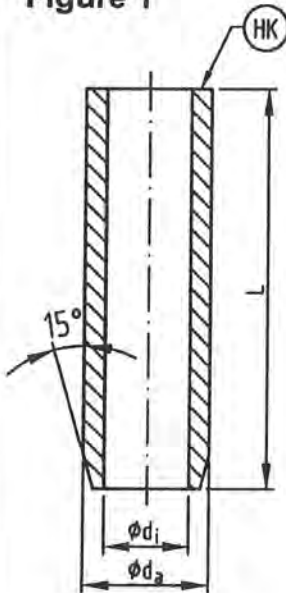

**Table 1**


## Extruded Coupler

Nominal Dia. Reinforcing Steel $d_s$ [mm]	Outer Dia. $d_a$ [mm]	Inner Dia. * $d_i$ [mm]	Coupler Dimensions Length L before Extruding Process	
			L [mm]	
16	28 $\pm 0,5$	19 $\pm 0,2$	130 $\pm 2$	
20	34 $\pm 0,5$	23 $\pm 0,2$	150 $\pm 2$	
25	45 $\pm 0,2$	30 $\pm 0,2$	160 $\pm 2$	
28	48 $\pm 0,2$	32 $\pm 0,2$	170 $\pm 2$	
32	58 $\pm 0,5$	38 $\pm 0,5$	230 $\pm 2$	

\*) Inner Diameter may also be smaller for Reinforcing Steel with lower deviation

Remarks: (HK) | Manufacturer Symbol

**Figure 2**

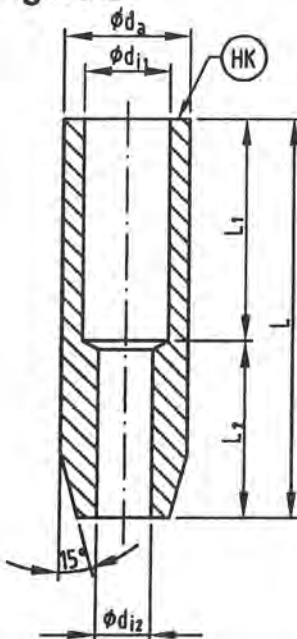

**Table 2**

## Extruded Reducing Coupler

Nominal Dia. Reinforcing Steel $d_{s1} / d_{s2}$ [mm]	Coupler Dimensions and permissible Tolerances					
	Outer Dia. $d_a$ [mm]	Inner Dia. * $d_{i1}$ [mm]   $d_{i2}$ [mm]		Length L [mm]   $L_1$ [mm]   $L_2$ [mm]		
20/16	34 $\pm 0,5$	23 $\pm 0,2$	19 $\pm 0,2$	140 $\pm 2$	75	65
25/20	45 $\pm 0,2$	30 $\pm 0,2$	23 $\pm 0,2$	155 $\pm 2$	80	75
28/25	48 $\pm 0,2$	32 $\pm 0,2$	30 $\pm 0,2$	165 $\pm 2$	85	80
32/28	58 $\pm 0,5$	38 $\pm 0,5$	32 $\pm 0,5$	200 $\pm 2$	115	85

\*) Inner Diameter may also be smaller for Reinforcing Steel with lower deviation

Remarks: (HK) | Manufacturer Symbol



DYWIDAG-Systems  
 International GmbH

www.dywidag-systems.com

## SYSTEM

**Extruded Coupler; Extruded Reducing Coupler**


**FLIMU – System BSt 500 S, BSt 420 S, Ø 16 – 32 mm**

Appendix Sheet 1  
 to Approval  
 Certificate


Nr. Z-1.5-150  
 vom 29. September 2009

**Figure 3 Examples for End Anchorages**

**At Tensile- and Compressive Load with Anchor Piece**

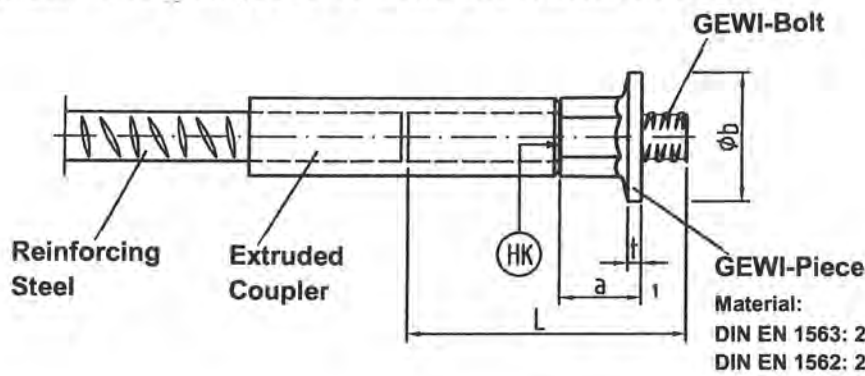

**At Tensile- and Compressive Load with Anchor Plate and Anchor Nut**

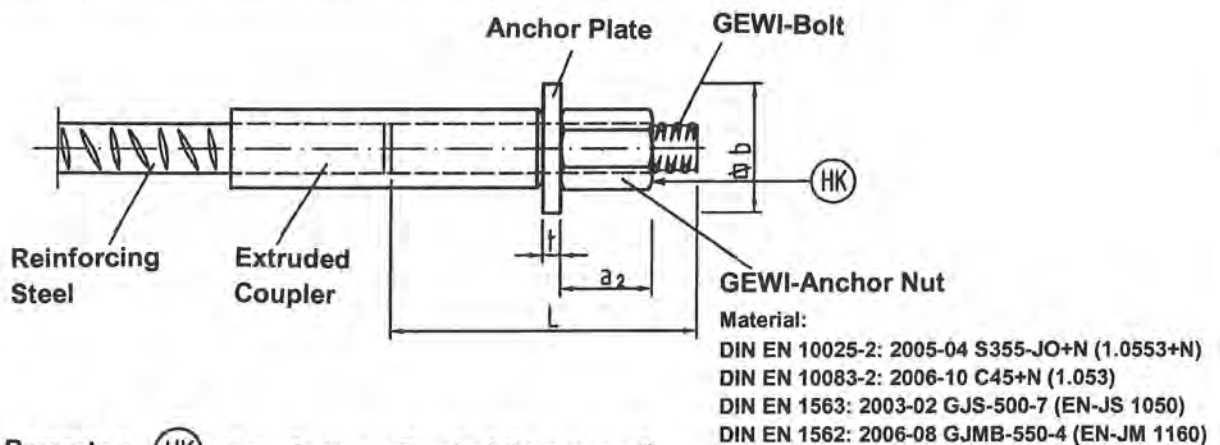

Remarks: (HK) Manufacturer Symbol (impressed)

**Table 3**

Nominal Dia. Reinforcing Steel $d_s$ [mm]	Torque Moment $M_{kont}$ [kNm]	GEWI-Bolt		Extruded Coupler	Anchor Piece $a_1$ [mm]	Anchor Nut $a_2$ [mm]	Anchor Plate		
		$d_s$ [mm]	$L$ [mm]				Thickness $t$ [mm]	Outer Dimension [mm]	Hole Dia. [mm]
16	0,20	16	140	see Appendix 1	35	50	8	50	20
20	0,35	20	165		40	65	10	60	25
25	0,70	25	180		45	75	12	70	30
28	0,95	28	200		50	85	14	85	33
32	1,60	32	240		60	90	15	100	38



Deutsches Institut für Bautechnik


**DSI**  
 DYWIDAG-Systems  
 International GmbH  
 www.dywidag-systems.com

**End Anchorage (torqued)**


**FLIMU – System BSt 500 S, BSt 420 S, Ø 16 – 32 mm**

Appendix Sheet 2  
 to Approval  
 Certificate  
 Nr. Z-15-150  
 vom 29. September 2009

Figure 4

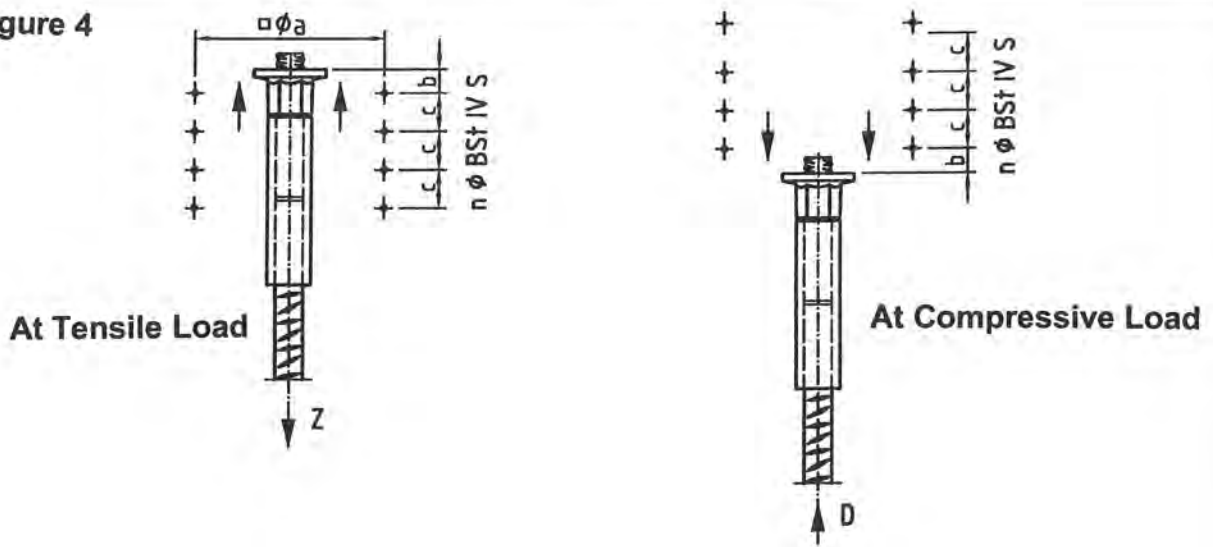

Non-staggered Anchorage

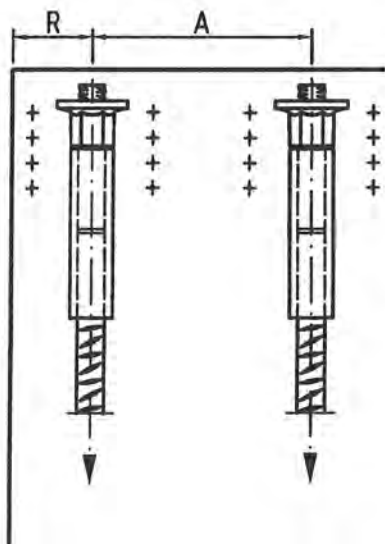

Staggered Anchorage

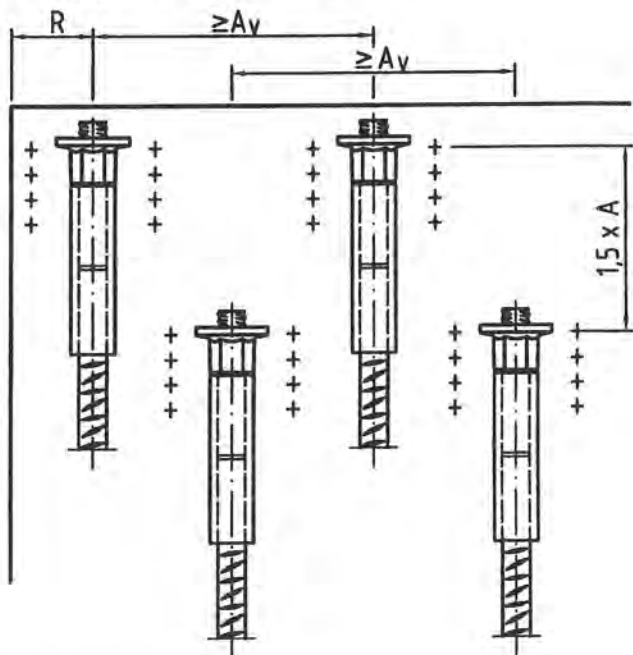


Table 4

Nominal Dia. Reinforcing Steel $d_s$ [mm]	Centre Distance		Edge Distance $R$ [mm]	Additional Reinforcement				
	$A$ [mm]	$A_v$ [mm]		$n$ [mm]	$d_s$ [mm]	$a$ [mm]	$b$ [mm]	$c$ [mm]
16	100	105	70	3	6	70	20	30
20	130	140	85	3	6	100	20	30
25	145	165	90	4	6	120	15	30
28	165	190	100	4	6	140	10	40
32	180	200	110	3	8	155	20	50



### Reducing Ring ( Die ) – Inner Diameter ( Nominal ) $d_{Ri}$

Bar Dia.	$d_s$ [mm]	16	20	25	28	32
	$d_{Ri}$ [mm]	$25^{+0.5}_{-0.2}$	$31^{+0.5}_{-0.2}$	$40^{+0.5}_{-0.2}$	$44^{+0.5}_{-0.2}$	$51,6^{+0.5}_{-0.2}$

### Required Ultimate Load of the Splice and Anchorage Reinforcing Steel BSt 500 S

Kind of Failure: (see section 4.3.2.(4))	Required Ultimate Load (kN) For Nominal Rebar-Dia. $d_s$ (mm)				
	16	20	25	28	32
a)	111	173	270	339	442
b) *)	131	204	319	400	522

### Reinforcing Steel BSt 420 S

Kind of Failure: (see section 4.3.2.(4))	Required Ultimate Load (kN) For Nominal Rebar-Dia. $d_s$ (mm)				
	16	20	25	28	32
a)	93	145	227	284	371
b) *)	110	171	268	336	438

\*) The herewith required values must not be achieved due to failure according to the kind of failure c) (see section 4.3.2. (4)) with the there given required carrying capacity and requirements to the uniform elongation.



**Austria**

DYWIDAG-Systems International GmbH  
 Alfred-Wagner-Strasse 1  
 4061 Pasching/Linz, Austria  
 Phone +43-7229-610 49 0  
 Fax +43-7229-610 49 80  
 E-mail dsi-a@dywidag-systems.at  
 www.dywidag-systems.at

**Belgium and Luxembourg**

DYWIDAG-Systems International N.V.  
 Industrieweg 25  
 3190 Boortmeerbeek, Belgium  
 Phone +32-16-60 77 60  
 Fax +32-16-60 77 66  
 E-mail info@dywidag.be  
 www.dywidag-systems.com

**France**

DSI-Artéon  
 146 Avenue du Bicentenaire  
 Z.I. Dagneux  
 01122 Montluel Cedex, France  
 Phone +33-4-78 79 27 82  
 Fax +33-4-78 79 01 56  
 E-mail dsi.france@dywidag.fr  
 www.dywidag-systems.fr

**Germany**

DYWIDAG-Systems International GmbH  
 Schuetzenstrasse 20  
 14641 Nauen, Germany  
 Phone +49-3321-44 18 0  
 Fax +49-3321-44 18 38  
 E-mail suspa@dywidag-systems.com  
 www.dywidag-systems.de

DYWIDAG-Systems International GmbH  
 Max-Planck-Ring 1  
 40764 Langenfeld, Germany  
 Phone +49-2173-79 02 0  
 Fax +49-2173-79 02 20  
 E-mail suspa@dywidag-systems.com  
 www.dywidag-systems.de

DYWIDAG-Systems International GmbH  
 Germanenstrasse 8  
 86343 Koenigsbrunn, Germany  
 Phone +49-8231-96 07 0  
 Fax +49-8231-96 07 40  
 E-mail suspa@dywidag-systems.com  
 www.dywidag-systems.de

DYWIDAG-Systems International GmbH  
 Siemensstrasse 8  
 85716 Unterschleissheim, Germany  
 Phone +49-89-30 90 50 100  
 Fax +49-89-30 90 50 120  
 E-mail dsihv@dywidag-systems.com  
 www.dywidag-systems.com

**Italy**

DYWIT S.P.A.  
 Via Grandi, 64  
 20017 Mazzo di Rho (Milano), Italy  
 Phone +39-02-934 68 71  
 Fax +39-02-934 68 73 01  
 E-mail info@dywit.it  
 www.dywit.it

**Netherlands**

DYWIDAG-Systems International B.V.  
 Veilingweg 2  
 5301 KM Zaltbommel, Netherlands  
 Phone +31-418-57 89 22  
 Fax +31-418-51 30 12  
 E-mail email@dsi-nl.nl  
 www.dywidag-systems.com

**Norway**

DYWIDAG-Systems International AS  
 Industriveien 7A  
 1483 Skytta, Norway  
 Phone +47-67-06 15 60  
 Fax +47-67-06 15 59  
 E-mail adm@dsi-dywidag.no  
 www.dywidag-systems.com

**Poland**

DYWIDAG-Systems International Sp. z o.o.  
 ul. Przywizka 4/68  
 80-174 Gdansk, Poland  
 Phone +48-58-300 13 53  
 Fax +48-58-300 13 54  
 E-mail dsi-polska@dywidag-systems.com  
 www.dywidag-systems.pl

**Spain**

DYWIDAG Sistemas Constructivos, S.A.  
 Avd/de la Industria, 4  
 Pol. Ind. la Cantuena  
 28947 Fuenlabrada (Madrid), Spain  
 Phone +34-91-642 20 72  
 Fax +34-91-642 27 10  
 E-mail dywidag@dywidag-sistemas.com  
 www.dywidag-sistemas.com

**United Kingdom**

DYWIDAG-Systems International Ltd.  
 Northfield Road  
 Southam, Warwickshire  
 CV47 0FG, Great Britain  
 Phone +44-1926-81 39 80  
 Fax +44-1926-81 38 17  
 E-mail sales@dywidag.co.uk  
 www.dywidag-systems.com/uk

AUSTRIA  
 ARGENTINA  
 AUSTRALIA  
 BELGIUM  
 BOSNIA AND HERZEGOVINA  
 BRAZIL  
 CANADA  
 CHILE  
 COLOMBIA  
 COSTA RICA  
 CROATIA  
 CZECH REPUBLIC  
 DENMARK  
 EGYPT  
 ESTONIA  
 FINLAND  
 FRANCE  
 GERMANY  
 GREECE  
 GUATEMALA  
 HONDURAS  
 HONG KONG  
 INDONESIA  
 ITALY  
 JAPAN  
 KOREA  
 LEBANON  
 LUXEMBOURG  
 MALAYSIA  
 MEXICO  
 NETHERLANDS  
 NORWAY  
 OMAN  
 PANAMA  
 PARAGUAY  
 PERU  
 POLAND  
 PORTUGAL  
 QATAR  
 SAUDI ARABIA  
 SINGAPORE  
 SOUTH AFRICA  
 SPAIN  
 SWEDEN  
 SWITZERLAND  
 TAIWAN  
 THAILAND  
 TURKEY  
 UNITED ARAB EMIRATES  
 UNITED KINGDOM  
 URUGUAY  
 USA  
 VENEZUELA